


Note	Position	Modified from	Date	Intr./Appd.
03		Title block updated & DN 220541 17 and CID28208	04-04-2022	INEX/PRP/PP



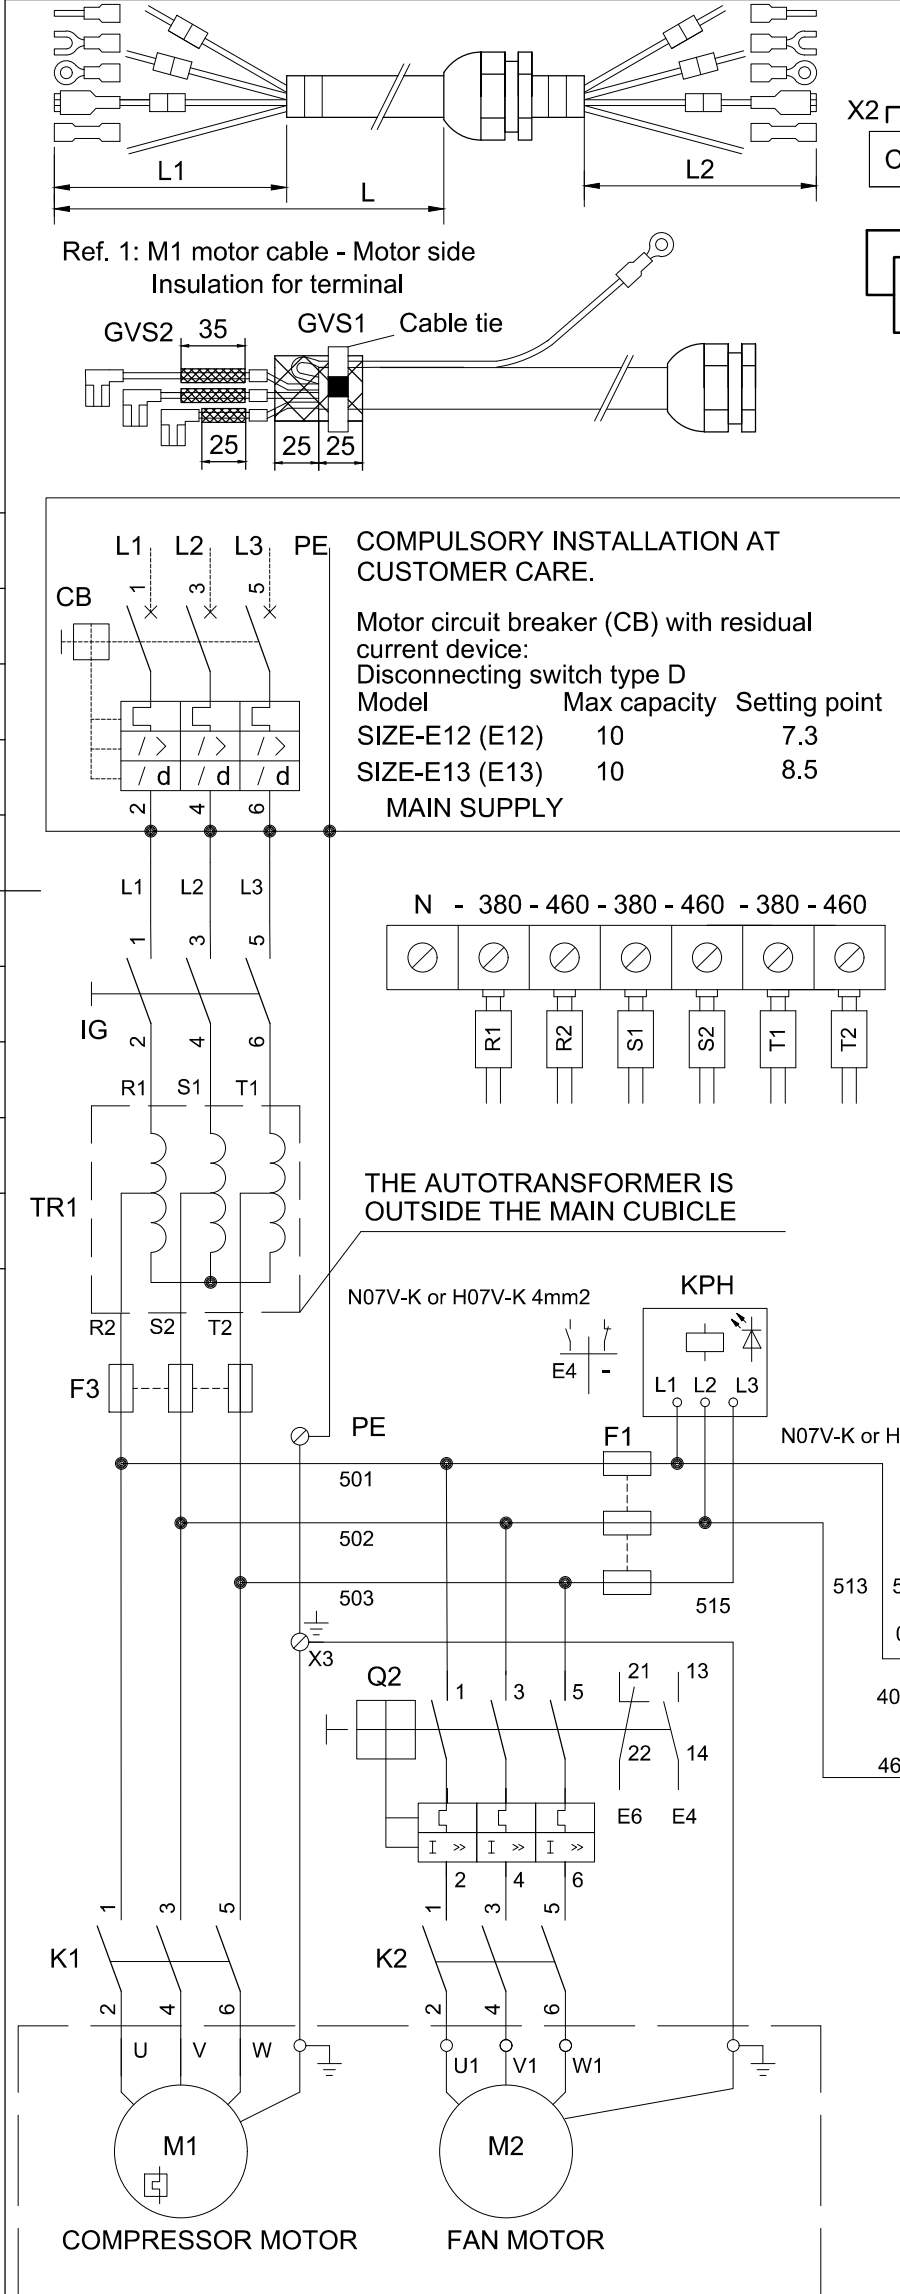


REMOTE FREE CONTACT
General Alarm maximum 10A/250Va.c. AC1
maximum 7.5A/250Vac pf=0,4

REMOTE FREE CONTACT
Drain Alarm maximum 10A/250Va.c. AC1
maximum 7.5A/250Vac pf=0,4

Q2
SETTING POINT
1,7A

- AP HIGH PRESSURE SWITCH
EV DRAIN SOLENOID VALVE
F1 PRIMARY TR FUSES
F2 SECONDARY TR FUSES
F3 SECONDARY AUTOTR. FUSES
H1 VOLTAGE PRESENCE LAMP
H2 FAULT LAMP
IG MAIN SWITCH
KPH PHASE SEQUENCE RELAY
K1 COMPRESSOR CONTACTOR
K2 FAN MOTOR CONTACTOR
Q2 FAN MOTOR OVERLOAD PROTECTION
K4 AUX. RELAY GENERAL ALARM
K5 AUX. RELAY DRAIN ALARM
K6 CONTROLLER COMPRESSOR RELAY
K7 CONTROLLER ALARM RELAY
PV FAN PRESSURE SWITCH
SL LEVEL SWITCH
TR AUXILIARY TRANSFORMER
TR1 MAIN SUPPLY AUTOTRANSFORMER
DC DIGITAL CONTROLLER
T1 NTC TEMPERATURE SENSOR
T2 PTC TEMPERATURE SENSOR

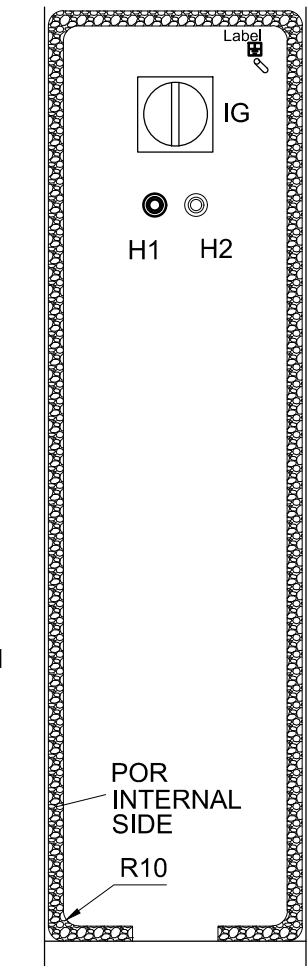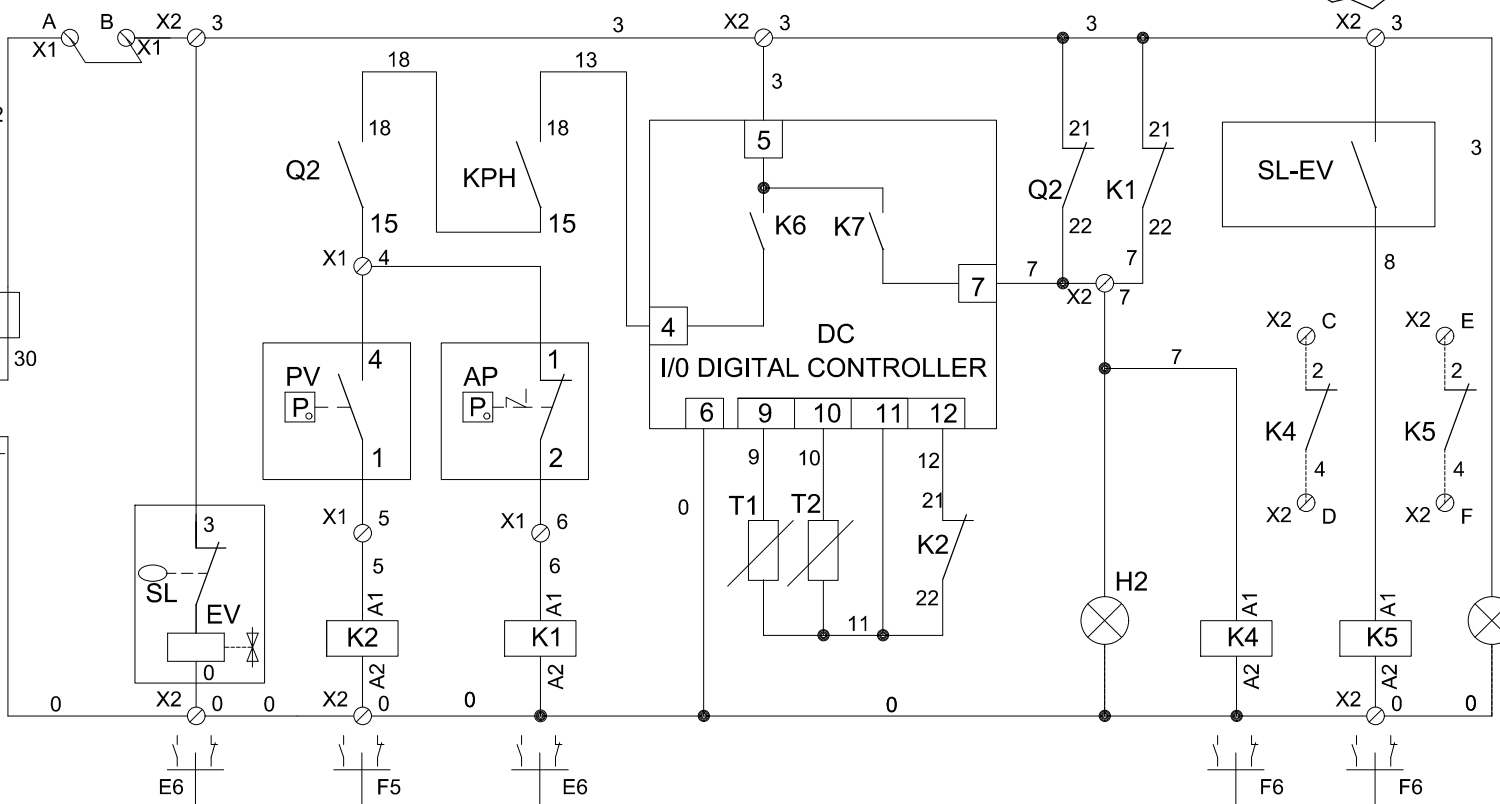

REMOTE START/STOP
before using these terminal you must
contact the customer service

