
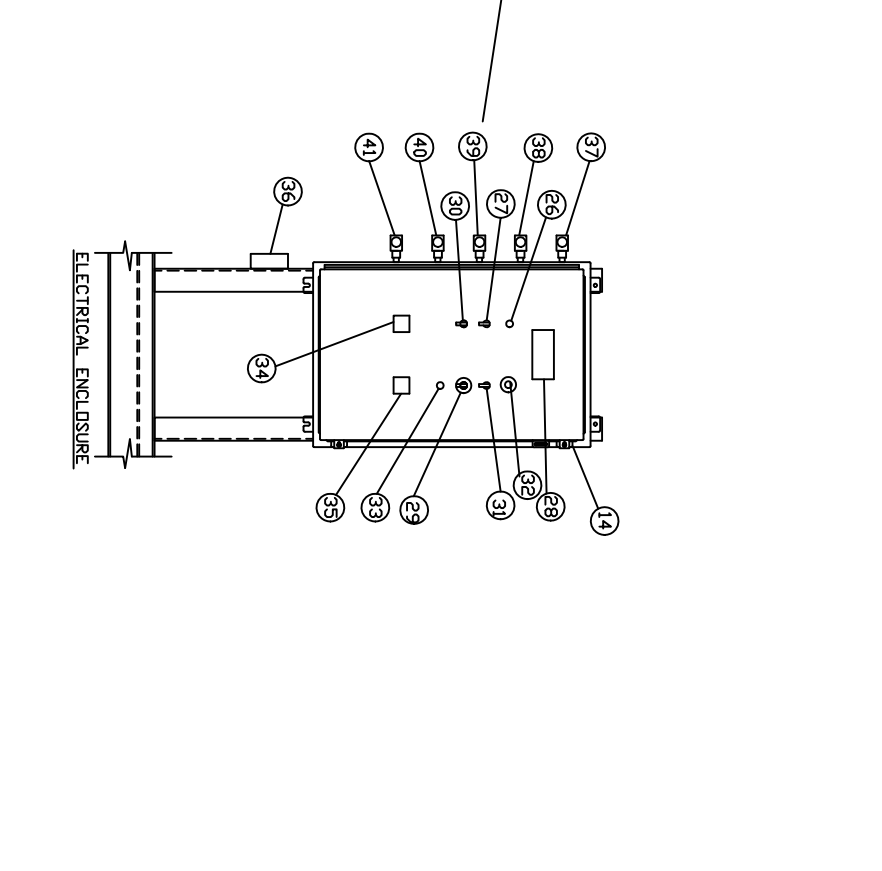


VIEW A-A
BOTTOM LINE PIPING

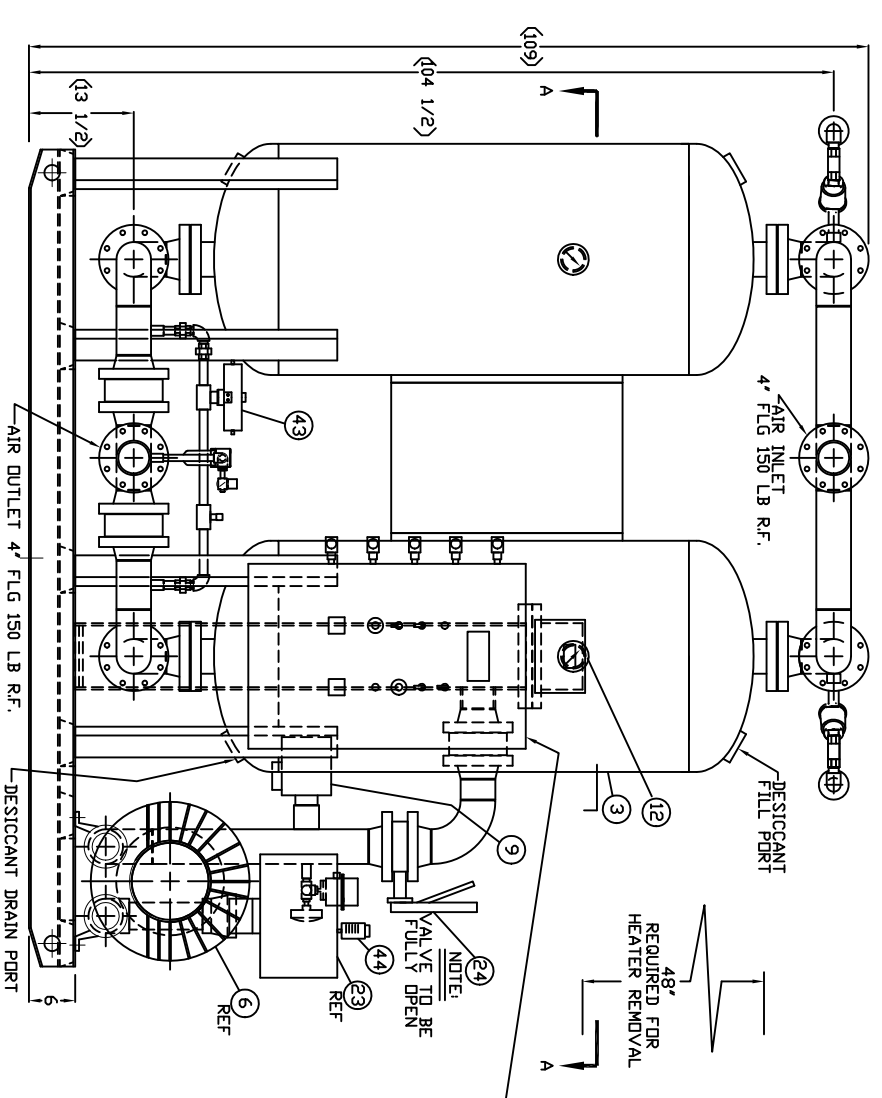

ITEM	QTY	DESCRIPTION
1	1	HEATER HOUSING
2	1	K-TYPE THERMOCOUPLE FOR HEATER TEMPERATURE CONTROL / PURGE AIR TEMP.
3	2	DESICCANT TOWER
4	1	HEATER 460VAC-3PH-60HZ
5	2	WAFFER STYLE OUTLET CHECK VALVE
6	1	BLOWER 460VAC-3PH-60HZ
7	1	REPRESSUREIZATION VALVE
8	2	PURGE CHECK VALVE
9	1	BLOWER PRESSURE RELIEF VALVE
10	1	BLOWER SAFETY CHECK VALVE
11	2	TOWER PRESSURE RELIEF VALVE SET@ 150 PSIG
12	2	TOWER PRESSURE GAUGE 0-200 PSIG
13	1	CONTROL AIR FILTER
14	1	ELECTRICAL ENCLOSURE
15	2	INLET VALVE
16	2	DEPRESSURIZATION VALVE
17	2	PURGE EXHAUST VALVE
18	1	PURGE EXHAUST (4\"/>

SPECIFICATIONS:

DESICCANT QUANTITY PER TOWER: 1250 LBS
 TOTAL DESICCANT: 2500 LBS
 DESICCANT TYPE: 3/16\"/>

NOTES:

- 1 ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED.
- 2 MARK/TAG COMPONENT WITH SULLIAR PART NUMBER AND REVISION.

TOLERANCES U.S.		FINISH:	
DIMENSIONS ARE IN INCHES	<input type="checkbox"/> UNLESS NOTED	AS CAST	UNLESS NOTED
ALL DIMENSIONS: ±.015"		AS CAST	UNLESS NOTED
ANGULAR DIMENSIONS: ±.01°		AS CAST	UNLESS NOTED
HOLE DIAMETERS: ±.003		AS CAST	UNLESS NOTED
DATE: 3-16-11	SCALE: 1:1	REV: 1	DF: 1
DATE: 3-16-11	SCALE: 1:1	REV: 1	DF: 1
DATE: 3-16-11	SCALE: 1:1	REV: 1	DF: 1